

电网与清洁能源

Power System and Clean Energy

中国科技核心期刊 China's Core Sci-Tech Journals

美国《乌利希期刊指南》收录期刊 Indexed by Ulrich's Periodicals Directory, United States
波兰《哥白尼索引》(IC)来源期刊 Source Periodicals for Index of Copernicus (IC), Poland

DIANWANG YU QINGJIENENGYUAN

本期关注
FOCUS



☐ 采用混合储能的风电场输出平滑控制

Output Smooth Control of Wind Farms with Hybrid Energy Storage

ISSN 1674-3814



主管单位 国家电网公司
主办单位 陕西省电力公司
西安理工大学水电土木工程建筑研究设计院
Authorities in Charge State Grid Corporation of China
Sponsor Shaanxi Electric Power Corporation
Design Academy of Water Conservancy Hydroelectric
Civil Engin&ARCH of Xi'an University of Technology

2013
12

目次

《电网与清洁能源》 2013年第12期·第29卷·总第173期·12月

智能电网

- 01 750 kV输变电工程复合外绝缘应用进展及展望 / 郑楠,朱岸明,王中阳,施荣,周庆庆,穆海宝
11 基于多目标优化的配电网负荷转移路径研究 / 白新雷,郭力萍,王凯
16 基于有色Petri网的微电网被动式孤网控制方法研究 / 董润楠,曹剑馨,梁庚
22 基于改进多种群遗传算法的节能环保多目标优化模型 / 韦杏秋,陈碧云,陈绍南
30 Lagrange力学在含TCSC电力系统Hamilton实现中的应用 / 殷婷,王杰
36 750 kV/330 kV混压同塔四回输电线路耐雷性能研究 / 温灵长,孙菊海
45 热电联产机组节能发电组合研究 / 王永庆,张宏,苏耕,强文,黄伟钢,郭新伟
50 考虑配电网馈线可用容量的负荷点可靠性区间分析 / 刘莎,王承民,黄湛华,李宏仲,邱文平
56 基于IEC标准的变电站监控运维数据建模的研究 / 李响,陈浩敏,陈波,习伟,郑小华
61 青藏联网工程VCU系统异常导致双极换相失败分析 / 厉瑜,宋国超,张彩友
66 基于层次分析法的电厂继电保护系统评价 / 邓旭阳,张弛,曹建东,陈志光
70 天中直流工程投产后西北电网运行控制模式研究 / 王鹏,王清让,任冲
75 厂站直流系统接地故障引起开关误跳闸的仿真与研究 / 金海望,董杰,张金祥,胡尊张,麻震烁,陈习文,王玉强,卢德均
81 四棵树电气化铁路牵引变电站供电方式分析 / 李勇杰,钱霞,陈江,常喜强
84 基于故障模式分析法对含DG的配电网供电可靠性评估 / 陈真清,黄氏德
88 2×1 000 MW机组现代化电厂建设技术创新和整体优化设计 / 张树臣
93 超高输电塔结构设计安全性研究 / 谭蓉,孙菊海,党康宁,岳啸
98 输电线路导线舞动及防舞措施 / 孙菊海,温灵长,谭蓉

清洁能源

- 101 平抑风电功率波动的储能容量经济配置方法 / 房旭雪,叶林,赵永宁,宋旭日
107 采用混合储能的风电场输出平滑控制 / 李冲,陈谦,陈霄逸,刘增金,李卓然
113 飞轮储能在区域电网中的调频应用及经济性分析 / 薛金花,叶季蕾,汪春,杨波,鄢盛驰
119 智能微网中铅酸电池储能系统控制策略 / 俞斌,桑丙玉,刘欢,李官军,华光辉,陶以彬,苏广宁
126 风速计安装间距对其测量偏差的影响研究 / 袁带英
131 永磁直驱风电系统故障穿越技术研究综述 / 张金平,汪宁渤,丁坤,马彦宏,周识远,李津

本刊送阅:

国务院、国家能源局、各省(区)政府电力、能源主管领导
国家电网、能源企业主要负责人
中国科学院、中国工程院院士
电力、能源相关学会、协会
中国国家图书馆、中国版本图书馆、各省(区)图书馆

Contents

Power System and Clean Energy
2013 Vol.29 No.12 (Ser.173) Monthly

Smart Grid


- 01 Progress and Prospect of Application of Composite External Insulation in the 750 kV Power Transmission Project / *ZHENG Nan, ZHU An-ming, WANG Zhong-yang, SHI Rong, ZHOU Qing-qing, MU Hai-bao*
- 11 Research on Distribution Network Load Transferring Path Based on Multi-Objective Optimization / *BAI Xin-lei, GUO Li-ping, WANG Kai*
- 16 Studies on the Control Method for the Passive Islanding of the Migro-Grid Based on Colored Petri Net / *DONG Run-nan, CAO Jian-xin, LIANG Geng*
- 22 Multi-Objective Optimization Model Based on Improved Multiple Population Genetic Algorithm Considering Energy Conservation and Environmental Protection / *WEI Xing-qiu, CHEN Bi-yun, CHEN Shao-nan*
- 30 Application of Lagrange Mechanics in the Hamilton Realization of Power System with TCSC / *YIN Ting, WANG Jie*
- 36 Research on Characteristics of Lightning Resistance of the 750 kV/330 kV Quadruple-Circuit Transmission Line on the Same Tower / *WEN Ling-chang, SUN Ju-hai*
- 45 Research on the Energy-Saving Generation Scheduling of CHP Units / *WANG Yong-qing, ZHANG Hong, SU Geng, QIANG Wen, HUANG Wei-gang, GUO Xin-Wei*
- 50 Interval Method for the Reliability Evaluation of Load Point with Consideration of the Available Capacity of Distribution Network Feeders / *LIU Sha, WANG Cheng-min, HUANG Zhan-Hua, LI Hong-zhong, QIU Wen-ping*
- 56 An IEC Standards-Based Modeling Method for Monitoring, Controlling, Operation and Maintenance Data in Substations / *LI Xiang, CHEN Hao-min, CHEN Bo, XI Wei, ZHENG Xiao-hua*
- 61 Failure Analysis of Bipolar Commutation Failure Caused by the Anomaly of the VCU System in the Qinhai-Tibet Interconnection Project / *LI Yu, SONG Guo-chao, ZHANG Cai-you*
- 66 Evaluation of Relay Protection System in the Power Plant Based on AHP / *DENG Xu-yang, ZHANG Chi, CAO Jian-dong, CHEN Zhi-guang*
- 70 Study on the Operation Control Mode of Northwest Power Grid after Tianzhong DC Project is Put into Operation / *WANG Peng, WANG Qing-rang, REN Chong*
- 75 Simulation and Study of the Breaker Mis-Trip Due to DC System Grounding Faults in the Plant Station / *JIN Hai-wang, DONG Jie, ZHANG Jin-xiang, HU Zun-zhang, MA Zhen-shuo, CHEN Xi-wen, WANG Yu-qiang, LU De-jun*
- 81 Analysis on Power Supply Modes of the Traction Power Substation for Sikeshu Electrified Railway / *LI Yong-jie, QIAN Xia, CHEN Jiang, CHANG Xi-qiang*
- 84 Reliability Evaluation of Distribution Network with DG Based on Failure Mode and Effect Analysis / *CHEN Zhen-qing, HUANG Min-de*
- 88 Technological Innovations and Overall Optimization Design in Building a 2 × 1 000 MW Modern Power Plant Unit / *ZHANG Shu-chen*
- 93 Research on Design Safety of Extra-High Transmission Tower Structure / *TAN Rong, SUN Ju-hai, DANG Kang-ning, YUE Xiao*
- 98 Conductor Galloping on Transmission Line and Anti-Galloping Measures / *SUN Ju-hai, WEN Ling-chang, TAN Rong*

Clean Energy

- 101 The Economic Allocation Method of Energy Storage Capacity for Smoothing Wind Power Fluctuations / *FANG Xu-xue, YE Lin, ZHAO Yong-ning, SONG Xu-ri*
- 107 Output Smooth Control of Wind Farms with Hybrid Energy Storage / *LI Chong, CHEN Qian, CHEN Xiao-yi, LIU Zeng-jin, LI Zhuo-ran*
- 113 Frequency Regulation Application and Economic Analysis of Flywheel Energy Storage in a Regional Power Grid / *XUE Jin-hua, YE Ji-lei, WANG Chun, YANG Bo, YAN Sheng-chi*
- 119 Control Strategy of Lead-Acid Batteries Energy Storage System in Smart Microgrid / *YU Bin, SANG Bing-yu, LIU Huan, LI Guan-jun, HUA Guang-hui, TAO Yi-bin, SU Guang-ning*
- 126 Influence of the Mounting Distance between the Anemometers on the Measurement Bias / *YUAN Dai-ying*
- 131 Overview of Fault Ride-Through for the Permanent Magnet Direct-Driven Wind-Power Generation System / *ZHANG Jin-ping, WANG Ning-bo, DING Kun, MA Yan-hong, ZHOU Shi-yuan, LI Jin*



国家电网
STATE GRID

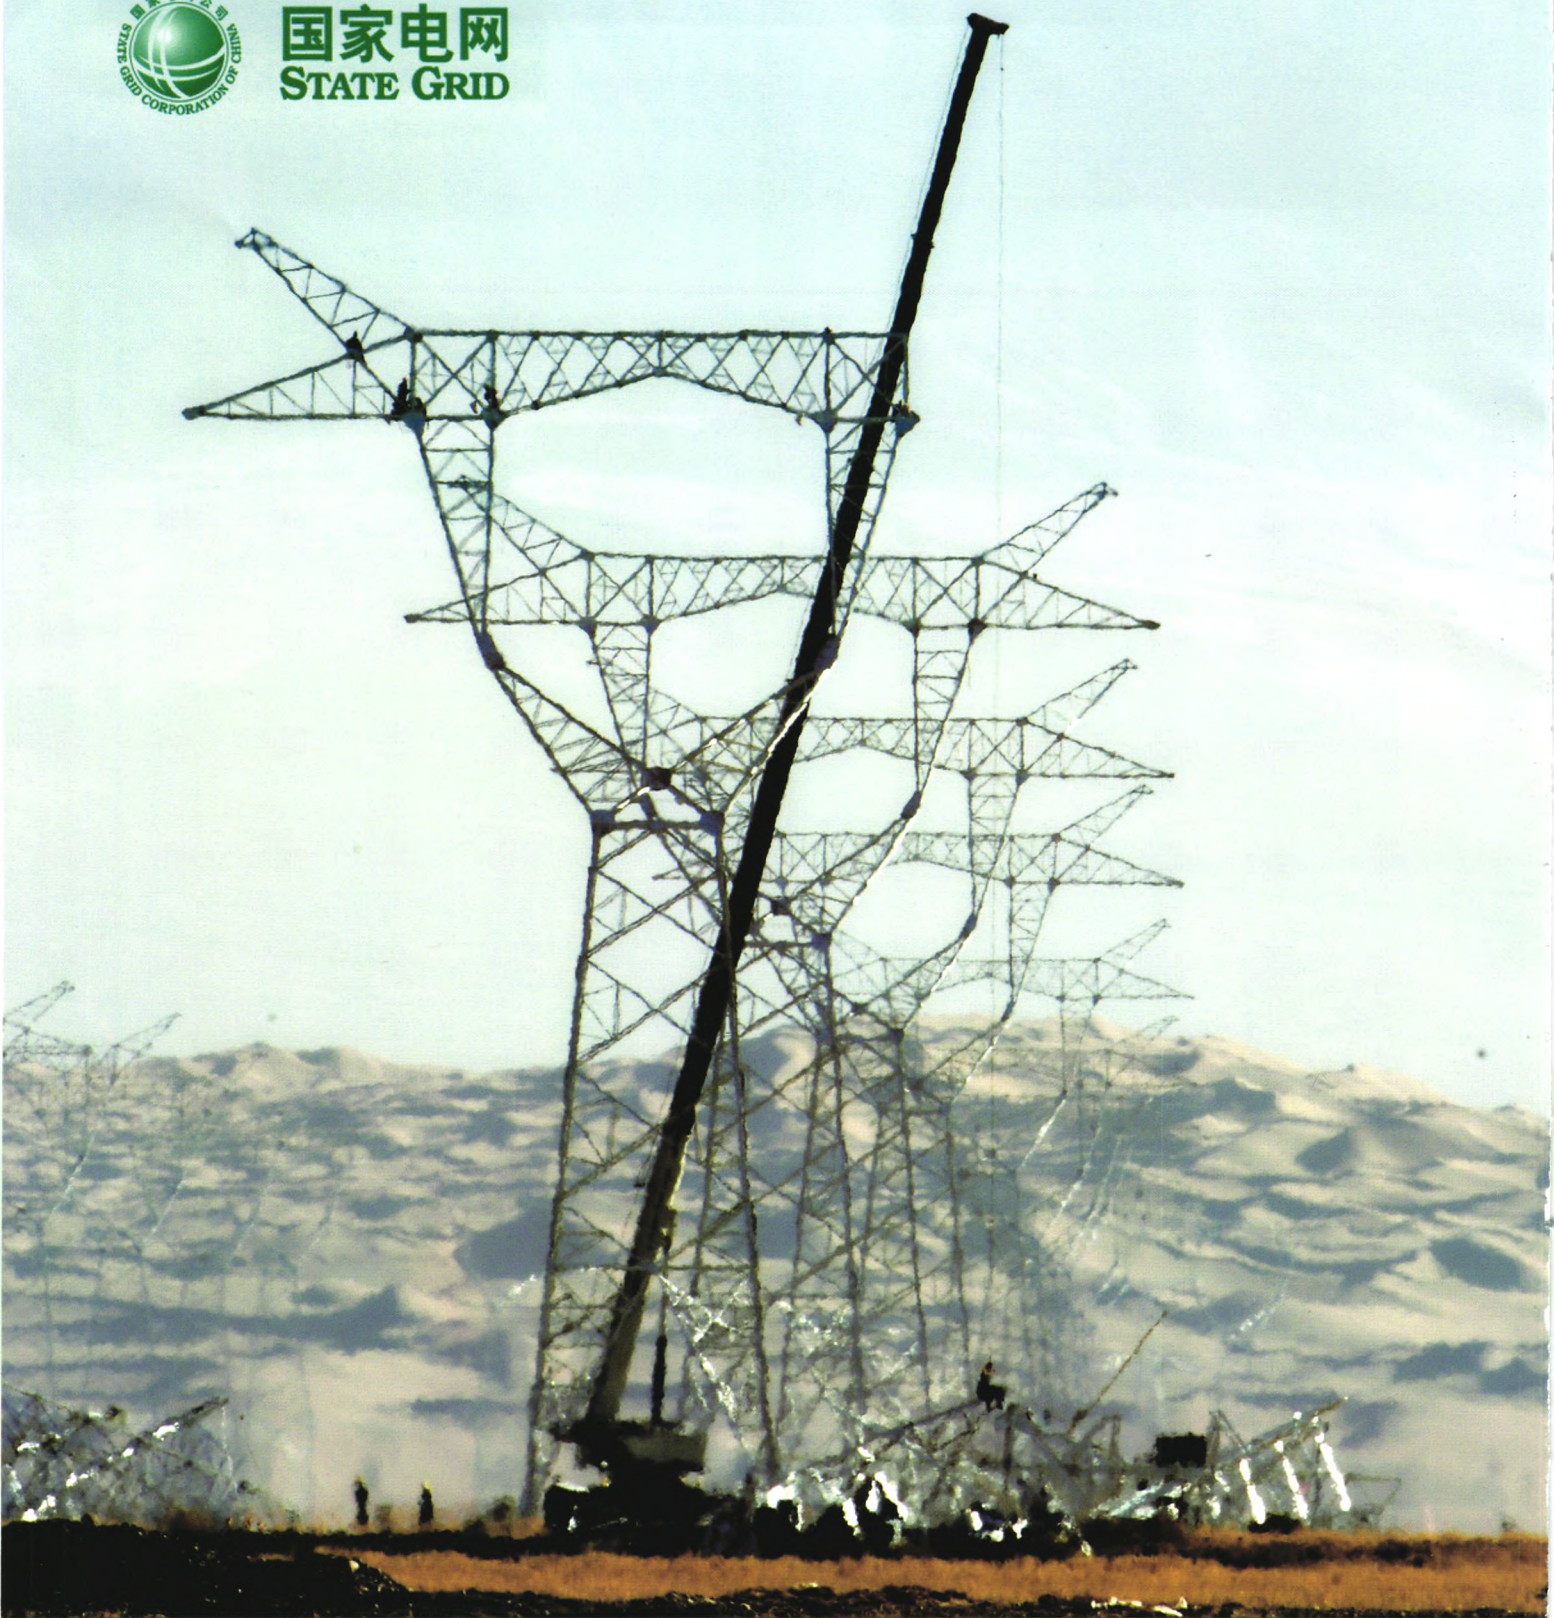

新疆与西北主网联网第二通道工程是国家电网公司坚持“一特四大”战略，实施能源集约化开发，建设能源电力大通道，推动西部大开发战略实施的重要工程，是继新疆、西藏与西北主网联网之后，进一步加强西北750千伏主网架建设的又一重大项目，也是实现“疆电外送”的重点项目。

工程新建750千伏哈密南、沙州变电站和鱼卡开关站，扩建750千伏哈密、敦煌和柴达木变电站，新增变电容量360万千瓦安，新建750千伏哈密-哈密换流站-哈密南-沙州-鱼卡-柴达木和沙州-敦煌双回输电线路全长2x1099公里。

截至1月20日，线路工程铁塔组立完成98.3%，共有20家单位完成100%；累计放线174公里；6个变电站土建基础设施总体进度接近90%，构架吊装完成，架空线正在施工。